



M.H. Ø	X' (MIN.)
1200 mm	1.35 m
1500 mm	1.50 m
1800 mm	1.65 m

SANITARY OBVERT BELOW STORM SPRINGLINE

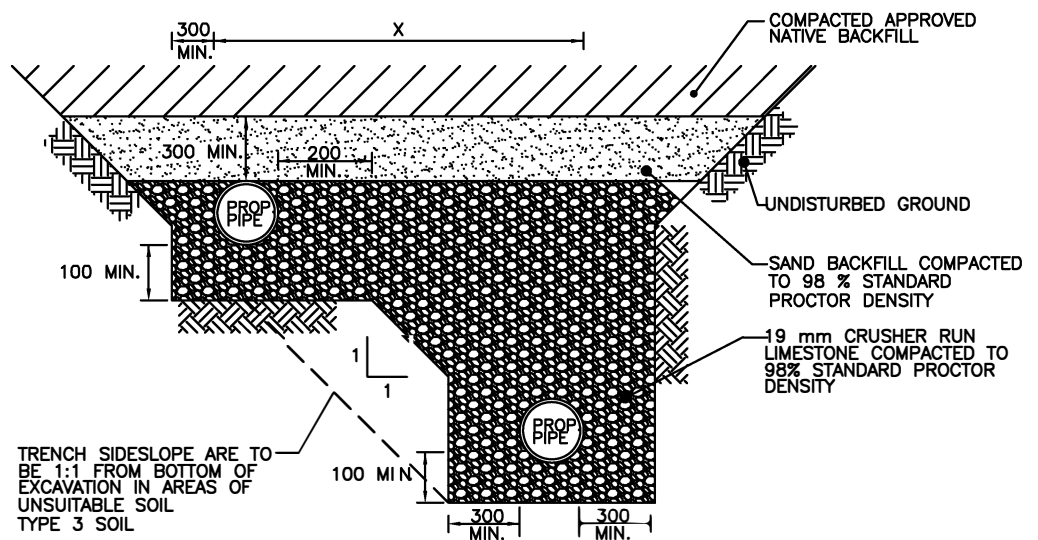

UNEVEN INVERTS

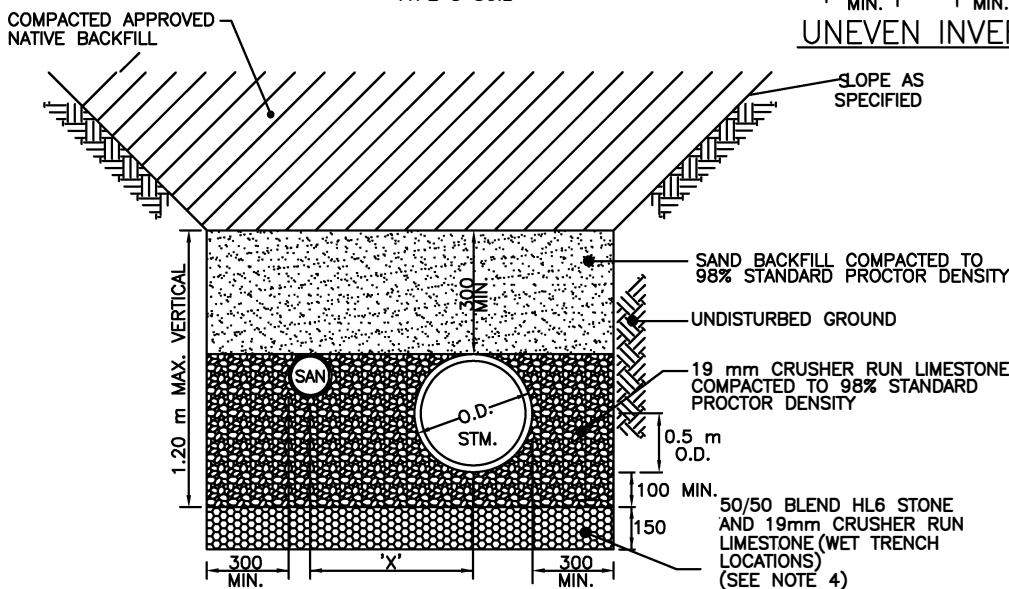

SANITARY INVERT ABOVE STORM SPRINGLINE

**NOTES:**

1. BEDDING MATERIALS SHALL BE FULLY EXTENDED AND COMPACTED AGAINST TRENCH WALLS. BEDDING MATERIALS SHALL BE PLACED AND COMPACTED IN 150 mm LAYERS. DEPTH TO ACCOMMODATE MUNICIPAL STANDARD.
2. NO MECHANICAL COMPACTION EQUIPMENT SHALL BE USED ON TOP OF A PIPE PRIOR TO PLACING A MINIMUM OF 300 mm COVER.
3. PIPE SHALL BE BEDDED TO PROPOSED LINE AND GRADE WITH UNIFORM AND CONTINUOUS SUPPORT FROM BEDDING. BLOCKING WITH ANY HARD OBJECT SHALL NOT BE USED TO BRING THE PIPE TO GRADE.
4. 50/50 BLEND OF HL6 STONE AND 19 mm CRUSHER RUN LIMESTONE IN WET AREAS OPSS 1004.
5. REFER TO S-200.010 FOR REQUIREMENTS IN WET TRENCH.
6. REFER TO S-200.010 FOR PIPE MATERIAL AND CLASS.

ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED.



WORKS DEPARTMENT

COMMON TRENCH BEDDING DETAIL FOR  
MAINLINE SANITARY SEWER AND  
STORM SEWER

DWG. DATE: 2001 01

REVISION NO.: 7 REV.

DATE: 2022 03

SCALE: N.T.S.

**S-100.040**