


**NEW PIPE**

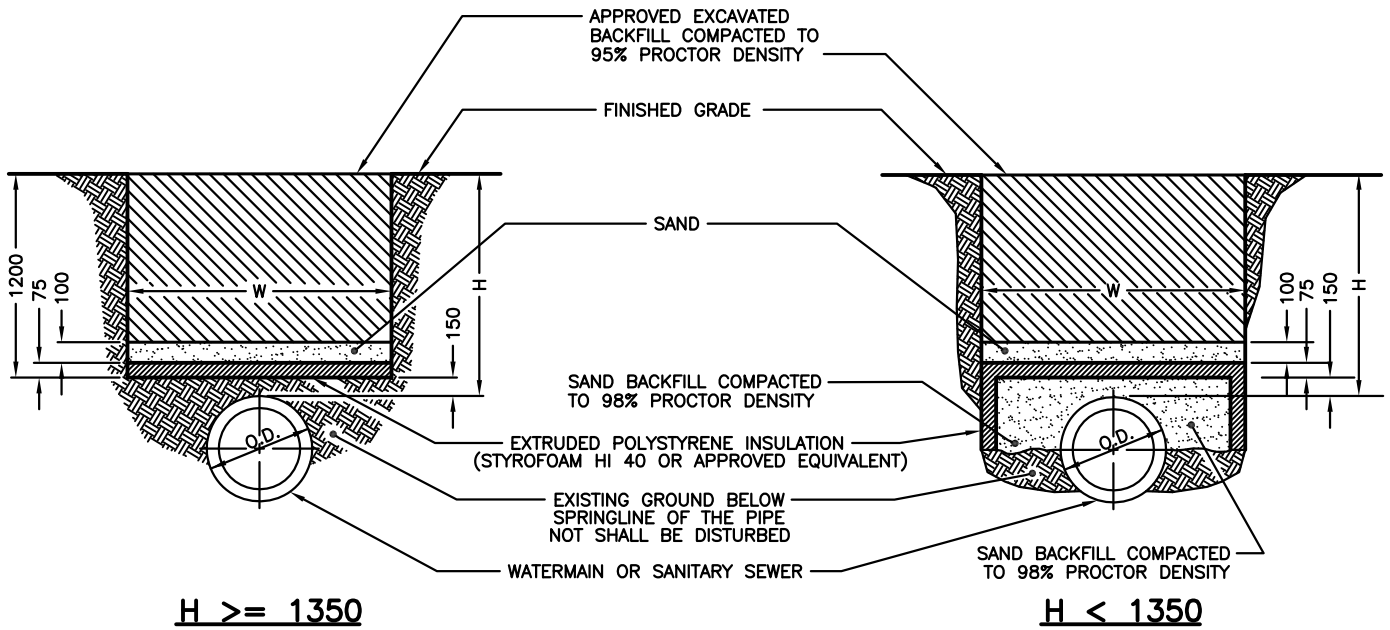

**H >= 1350**

**H < 1350**

**EXISTING PIPE**

**NOTES**

W = O.D. + 2 (1500 - H) OR O.D. + 600 mm WHICHEVER IS GREATER.  
 WHERE W = INSULATION WIDTH  
 O.D. = OUTSIDE DIAMETER OF PIPE SHALL BE INSULATED  
 H = DEPTH OF PIPE SHALL BE INSULATED  
 (MINIMUM = 1200 mm)

ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED.



WORKS DEPARTMENT

**METHODS OF INSULATING  
 SANITARY SEWERS AND WATERMAINS**

DWG. DATE: 1980 02  
 REVISION NO.: 9  
 REV. DATE: 2013 04  
 SCALE: N.T.S.

**S-100.050**