


**SHORT SIDE OR LONG SIDE CONNECTION**

**NOTES**

1. VALVE LOCATION SHALL BE DETERMINED BY REGION OF DURHAM.
2. CONNECTION LAYOUT SHALL BE DETERMINED BY THE REGION OF DURHAM.
3. BLOWOFFS SHALL BE PROVIDED AS PER S-210.060.
4. 19 mm DIA. TEST POINTS SHALL BE PROVIDED ON CONNECTIONS LARGER THAN 50 mm, AND 6 METRES IN LENGTH OR MORE.
5. LONG SIDE WATER SERVICES REQUIRE AN ADDITIONAL PROPERTY LINE VALVE.

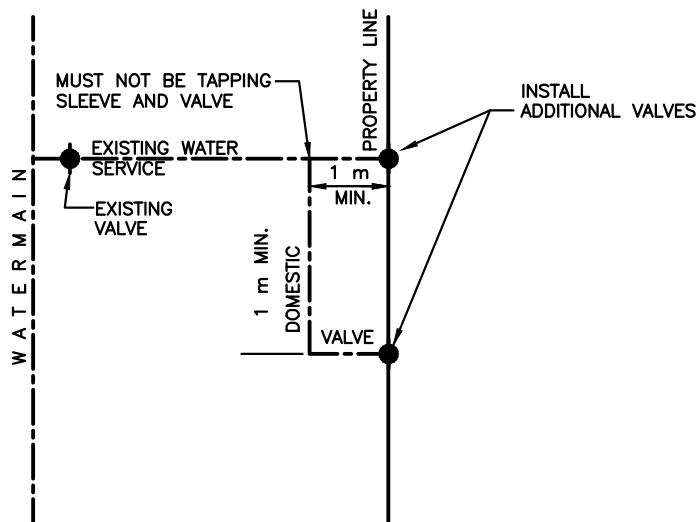

**DOMESTIC CONNECTION  
TO EXISTING/PROPOSED WATER  
SERVICE (LONG SIDE ONLY)**

ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED.



WORKS DEPARTMENT

**PIPING & FITTINGS FOR COMMERCIAL,  
INDUSTRIAL & MULTI-RESIDENTIAL  
CONNECTIONS (DOMESTIC & FIRELINE)**

DWG. DATE: 1988 09
REVISION NO.: 10
REV. DATE: 2022 02
SCALE: N.T.S.

**S-230.011**