



**NON-FERROUS WM**

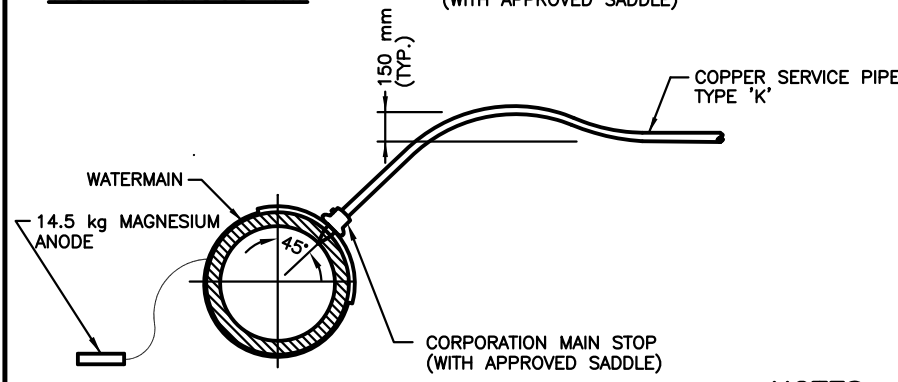

**FERROUS WM**

**NOTES:**

1. THE WATER CONNECTION SHALL BE LAID FROM THE MAIN TO 150 mm BEYOND THE PROPERTY LINE, IN NEW SUBDIVISIONS ONLY.
2. HORIZONTAL GOOSE NECK TO BE USED WHEN COVER LESS THAN 1700 mm.
3. WATERMAIN TO BE TAPPED UNDER PRESSURE.
4. SERVICE GROUND CLAMPS AND SPLIT BOLT SHALL BE WRAPPED WITH ELECTRICAL PUTTY.
5. ANODE TO BE PLACED AT LEAST 1.0 m AWAY FROM THE SERVICE AND AS DEEP AS THE BOTTOM OF THE SERVICE.
6. ANODE SHALL BE LOCATED BETWEEN THE MAIN STOP AND CURB STOP.
7. PLUMBING CONTRACTOR TO REMOVE TAIL PIECE AND HOOK UP TO CURB STOP.
8. CATHODIC PROTECTION, BONDING CABLE AND TRACER WIRE SHALL BE AS PER S-201.030, S-201.031.

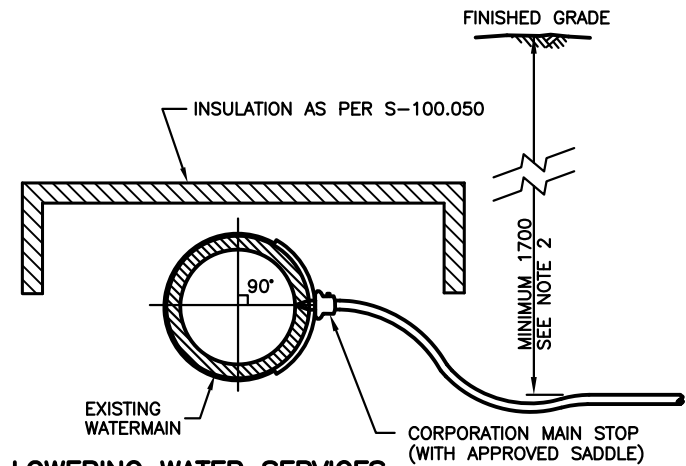

**LOWERING WATER SERVICES**

ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED



**37 mm AND 50 mm COPPER WATER SERVICE**

DWG. DATE:	2007 04
REVISION NO.	2
REV. DATE:	2014 04
SCALE:	N.T.S.

**S-230.021**