


NOTES

1. THE WATER METER SHALL BE READILY ACCESSIBLE.
2. THE WATER METER LOCATION SHALL BE LOCATED WHERE THE SERVICE PIPE ENTERS A BUILDING'S FULL BASEMENT OR IN ANOTHER AREA OF A BUILDING OR LOCATION APPROVED BY THE REGION OF DURHAM.
3. WATER METERS SHALL BE INSTALLED, SEALED, REPLACED MAINTAINED, REPAIRED, TESTED, INSPECTED AND REMOVED ONLY BY EMPLOYEES OR AGENTS OF THE REGION OF DURHAM.
4. A FULL PORT, STOP AND WASTE CORPORATION VALVES (GATE OR BALL TYPE) MUST BE INSTALLED ON BOTH THE INLET AND OUTLET SIDE OF THE METER.
5. SELECT A LOCATION FOR THE RECEPTACLE WHICH IS AS CLOSE AS POSSIBLE TO THE METER AND WHICH PROVIDES A SUITABLE POINT FOR A DRILLED HOLE. LOCATION OF REMOTE READING RECEPTACLE SHOULD BE ACCESSIBLE, PREFERABLY BESIDE AN ELECTRIC OR GAS METER ON THE DRIVEWAY SIDE OR FRONT OF THE BUILDING.
6. WHERE NO BASEMENT EXISTS, A 3 WIRE CABLE MUST BE RUN FROM THE WATER METER TO A LOCATION WHERE THE REMOTE READING DEVICE RECEPTACLE IS ACCESSIBLE. PREFERABLY BESIDE AN ELECTRIC OR GAS METER ON THE DRIVEWAY SIDE OR FRONT OF THE BUILDING.
7. IF THE 3 WIRE RECEPTACLE-TO-ENCODER CABLE RUNS NEAR OR INTO THE GROUND, PROTECT IT FROM LAWN MAINTENANCE EQUIPMENT BY PLACING THE WIRE INSIDE A PIECE OF PVC PIPE. ANCHOR THE PIPE INTO THE GROUND AND STRAP IT TO THE MOUNTING SURFACE.
8. PROVIDE 1.0 m EXCESS WIRE AT EACH END FOR SUBSEQUENT HOOKUP AT READING DEVICE AND AT METER.
9. STEEL PIPE OF ANY TYPE SHALL NOT BE USED AS A SPACER PRIOR TO THE WATER METER BEING INSTALLED.



ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED.

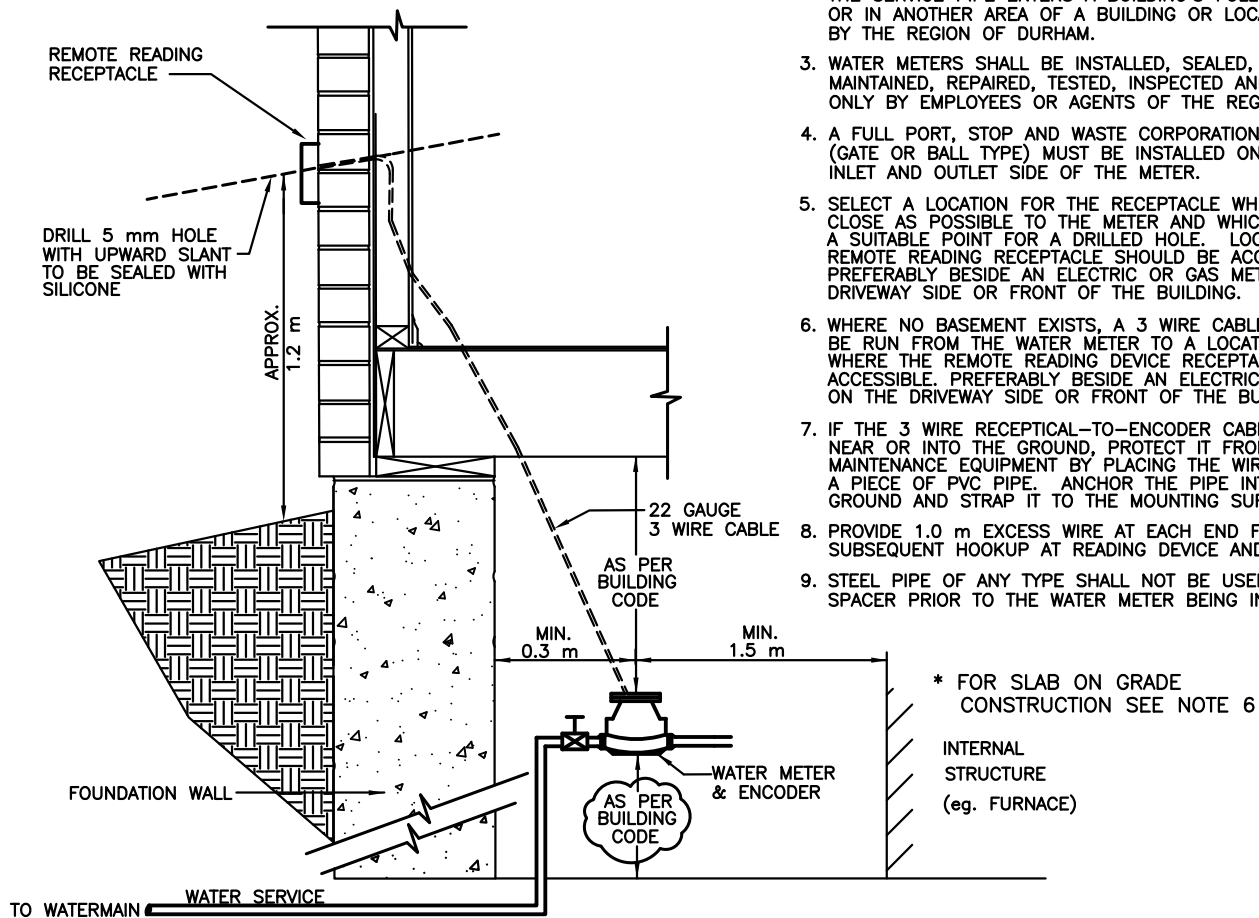

**METER, VALVE,
REMOTE READING DEVICE AND
WIRE INSTALLATION**

DWG. DATE: 1995 02
REVISION NO.: 7
REV. DATE: 2019 04
SCALE: N.T.S.

S-240.010